


PLAN
SCALE: 1"=40'

- NOTES:
- CONTRACTOR SHALL SUPPLY WATER WITH TEMPORARY WATER MAIN TO ALL CUSTOMERS WHO WILL BE WITHOUT WATER LONGER THAN FOUR (4) HOURS.
 - CONTRACTOR SHALL REPLACE BROKEN LATERAL GATE VALVES AS DIRECTED BY THE ENGINEER AND WHERE IT IS NECESSARY TO OBTAIN A DRY PIPE FOR CLEANING AND LINING.
 - CONTRACTOR SHALL REPLACE ALL NOTED NON-COPPER SERVICES TO PROPERTY LINE OR AS DIRECTED BY ENGINEER.
 - CONTRACTOR SHALL REMOVE GATE VALVES DESIGNATED AS "NEW" AND DELIVER TO AREA DESIGNATED BY OWNER.
 - WORK IN THE INTERSECTION OF NORTH MAIN STREET, CENTER STREET SOUTH MAIN STREET AND WAREHAM STREET SHALL BE DONE BETWEEN THE HOURS OF 9:00 PM AND 4:00 AM.

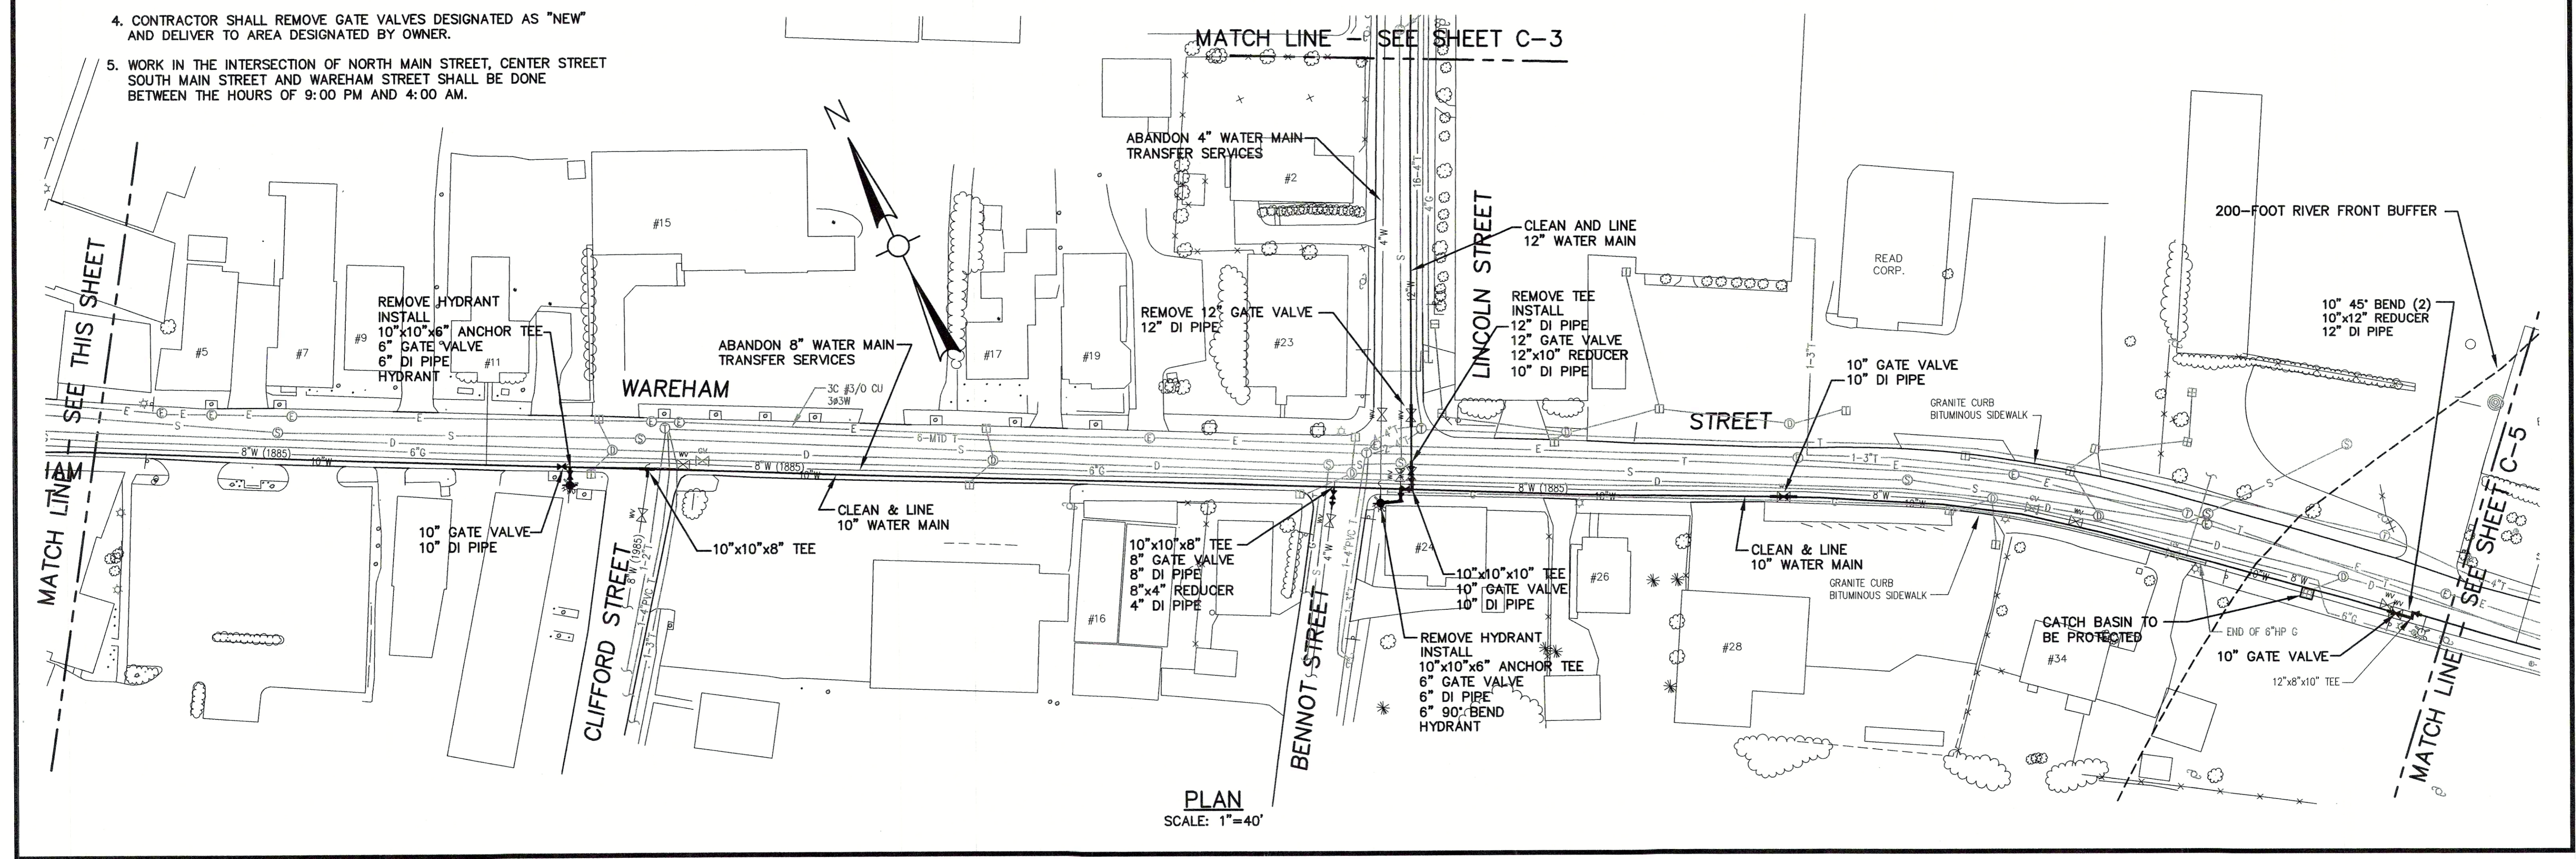

PLAN
SCALE: 1"=40'

Weston & Sampson ENGINEERS, INC.

Weston & Sampson Engineers, Inc.
Five Centennial Drive, Peabody, MA 01960

1899

No.	Date	Dr. By	Ck. By	App. By	Description

REGISTERED PROFESSIONAL ENGINEER

DATE: 6-27-03

TOWN OF MIDDLEBOROUGH, MASSACHUSETTS
BOARD OF SELECTMEN

2003 WATER MAIN CLEANING AND LINING PROJECT

SCALE: 1"=40'

CONTRACT: 03-02

NOTED

JOB NO. 202426

DR. BY PJS

DIS. BY MAM

CHK. BY BKC


APP. BY BWA

FILE NO. 145-100

CAD. NO. MBORO-1

C-4


SHEET 6 OF 13

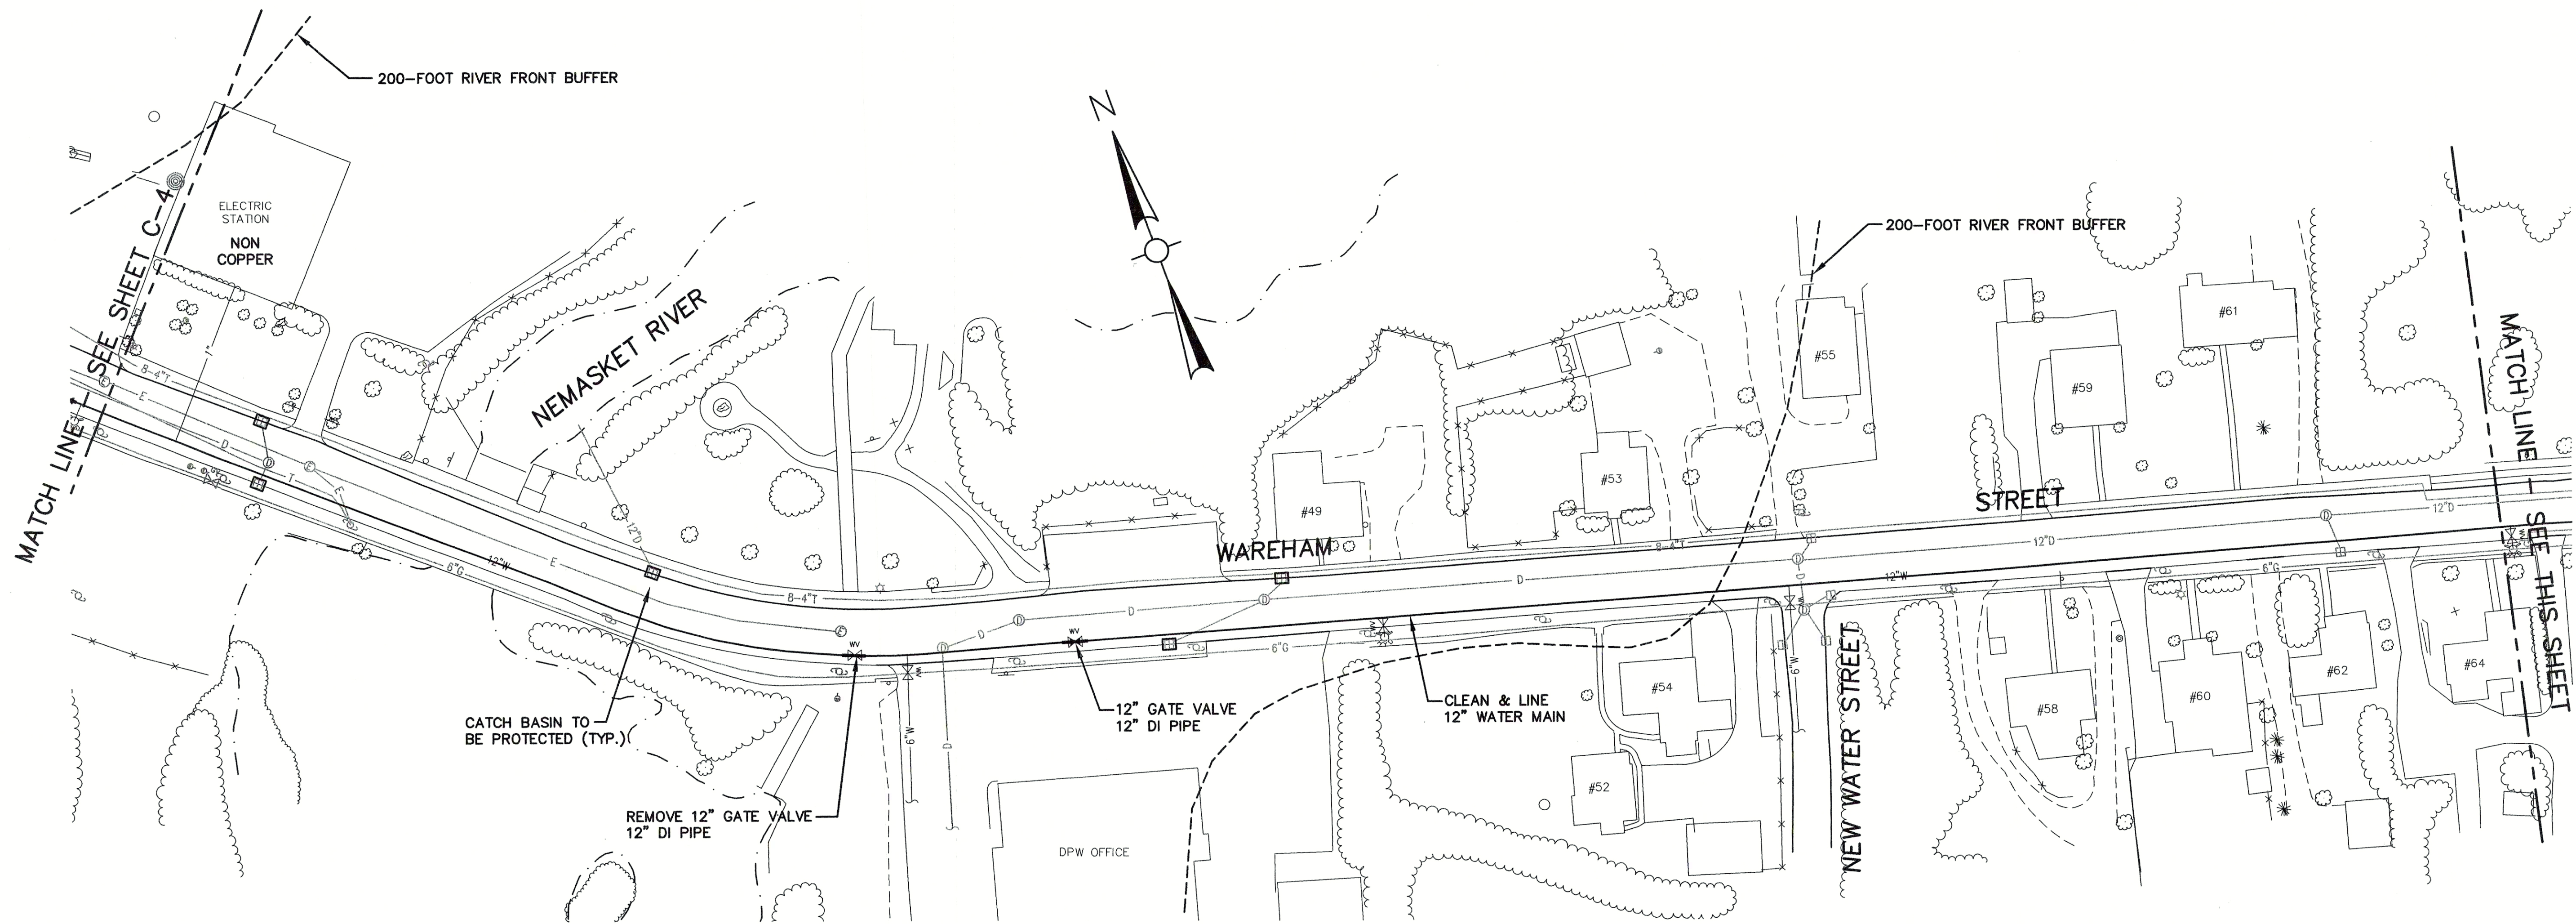

PLAN
SCALE: 1"=40'

NOTES:


1. CONTRACTOR SHALL SUPPLY WATER WITH TEMPORARY WATER MAIN TO ALL CUSTOMERS WHO WILL BE WITHOUT WATER LONGER THAN FOUR (4) HOURS.
2. CONTRACTOR SHALL REPLACE BROKEN LATERAL GATE VALVES AS DIRECTED BY THE ENGINEER AND WHERE IT IS NECESSARY TO OBTAIN A DRY PIPE FOR CLEANING AND LINING.
3. CONTRACTOR SHALL REPLACE ALL NON-COPPER SERVICES TO PROPERTY LINE OR AS DIRECTED BY ENGINEER.

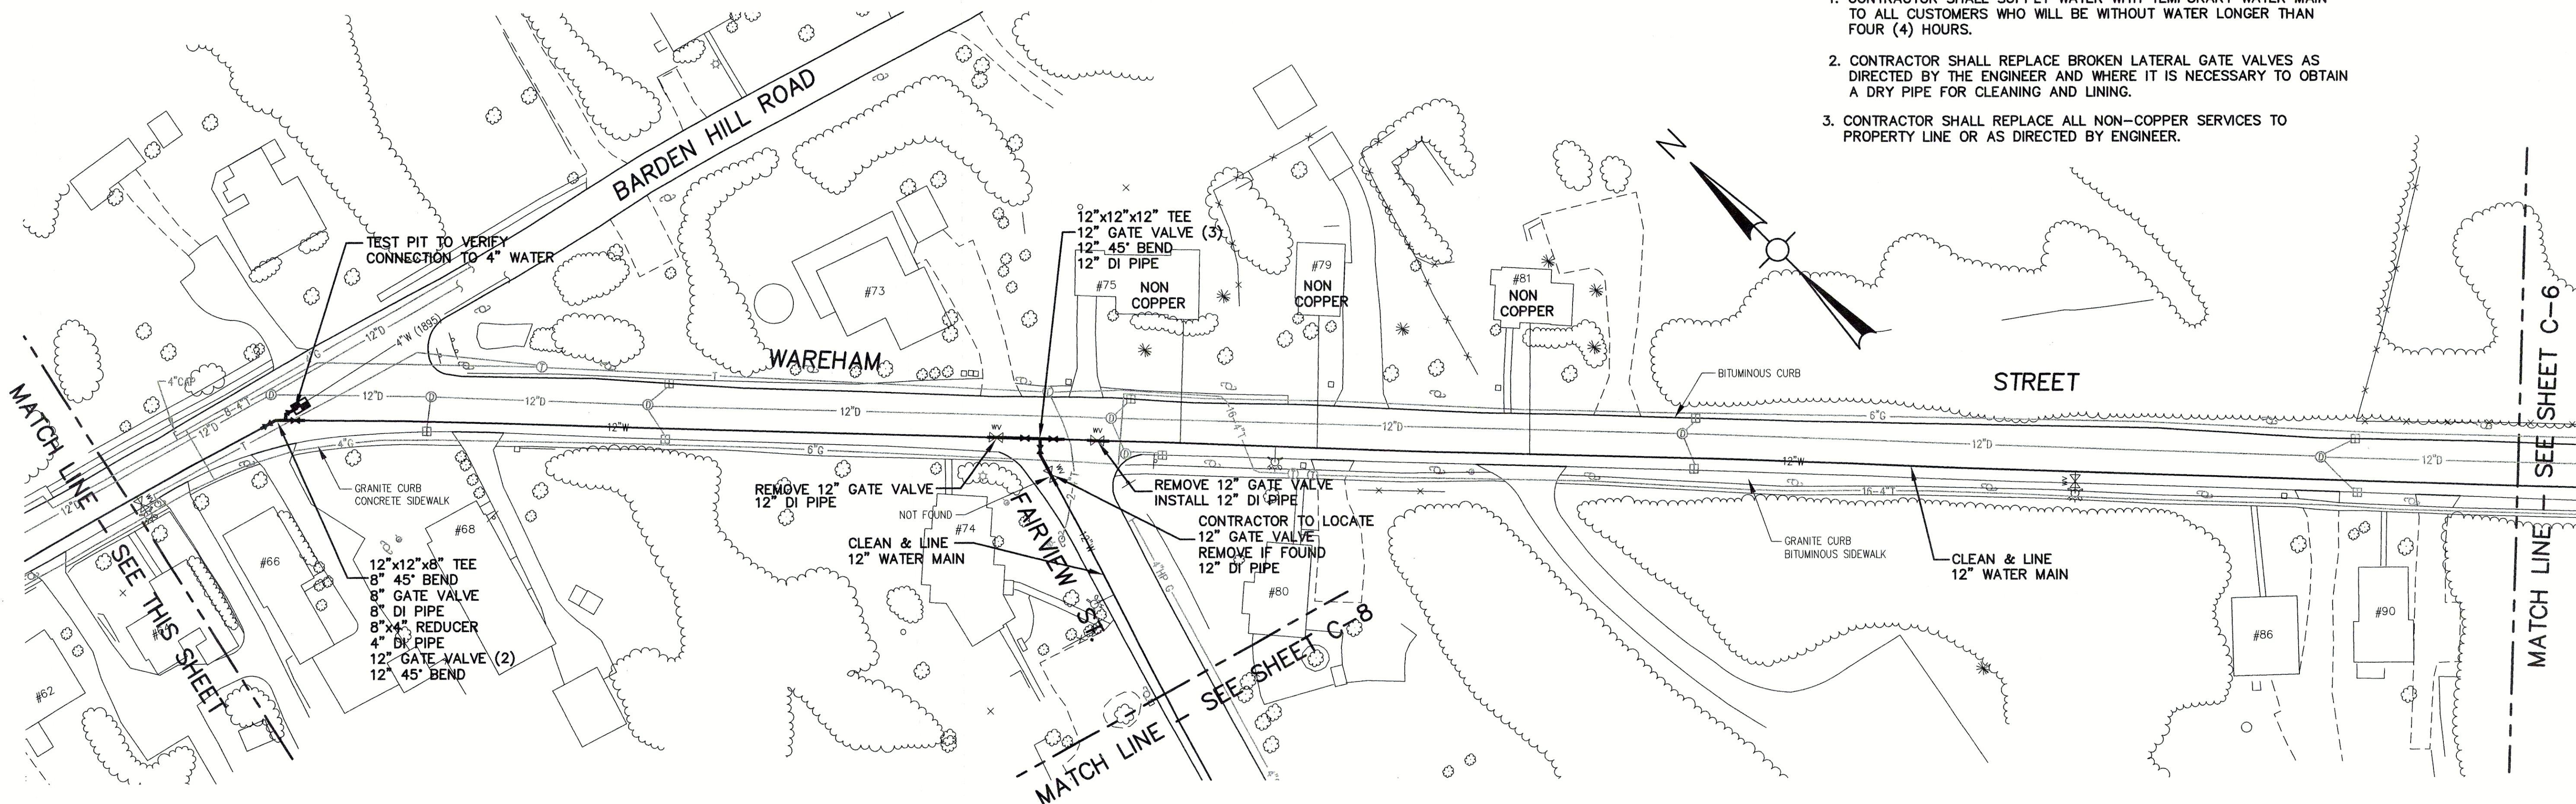

PLAN
SCALE: 1"=40'

No.	Date	Dr. By	Ck. By	App. By	Description
					A P P R O V E D

6-21-03 DATE

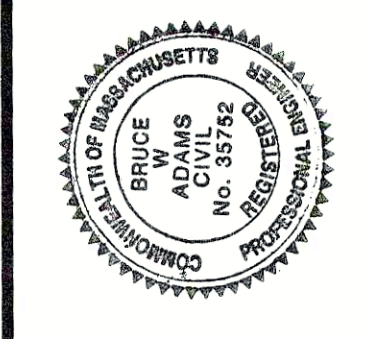

TOWN OF MIDDLEBOROUGH, MASSACHUSETTS
BOARD OF SELECTMAN

2003 WATER MAIN CLEANING AND LINING
WAREHAM STREET

CONTRACT:	03-02	JOB NO.:	202426	DR. BY:	PJS	PSN. BY:	MAM	CHK. BY:	BKC	APP. BY:	BWA
-----------	-------	----------	--------	---------	-----	----------	-----	----------	-----	----------	-----

FILE NO.:	145-99	CADD NO.:	MBORO-1	SCALE:	NOTED
-----------	--------	-----------	---------	--------	-------